

Southwest Power Pool, Inc. Corporate Metrics

for the period ending
April 30, 2008



Southwest Power Pool

Corporate Metrics

Table of Contents

Transmission & Market Indicators	
1	Active transmission limit control indicators
2	Regional control performance
3	Transmission utilization proxy
4	EIS prices and price range
5	Congestion
6	Market liquidity


Financial Metrics	
7	SPP Admin Fee performance
8	Financial settlement index
9	Financial disputes index
10	Budget performance monitor

Learning & Growth	
11	Employee turnover

Performance	
12	Compliance with NERC Standards
13	IT System Performance

14 Metrics Definitions


1. Active transmission limit control indicators

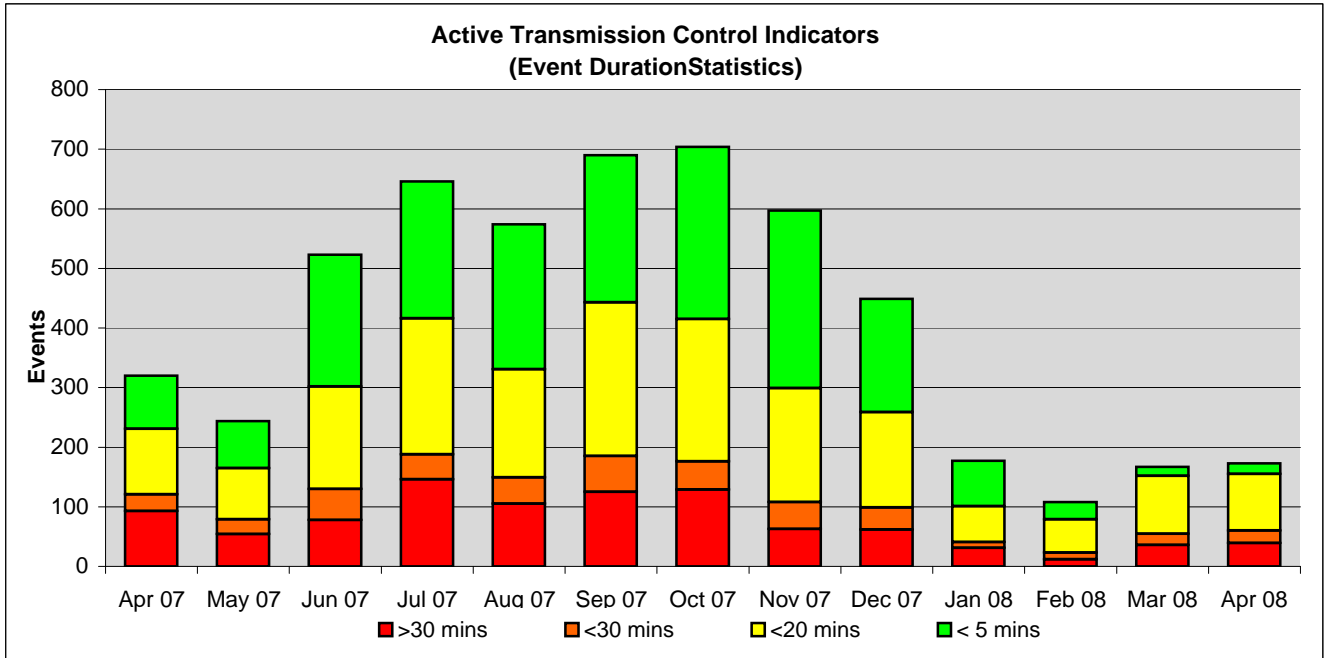


Duration	Apr 07	May 07	Jun 07	Jul 07	Aug 07	Sep 07	Oct 07	Nov 07	Dec 07	Jan 08	Feb 08	Mar 08	Apr 08
< 5 mins	89	79	221	230	243	247	289	298	190	76	29	15	18
<20 mins	110	86	172	228	182	258	239	191	160	60	56	97	95
<30 mins	28	25	52	42	44	60	47	45	37	10	11	19	21
>30 mins	93	54	78	146	105	125	129	63	62	31	12	36	39

	Apr 07	May 07	Jun 07	Jul 07	Aug 07	Sep 07	Oct 07	Nov 07	Dec 07	Jan 08	Feb 08	Mar 08	Apr 08
Total Mins	1600	1220	2615	3230	2870	3450	3520	2985	2245	885	540	835	865
(Mins<5)/(Mins>5)	2.60	2.09	1.37	1.81	1.36	1.79	1.44	1.00	1.36	1.33	2.72	10.13	8.61
Longest Event	755	350	495	410	615	590	945	460	670	142	180	340	230
MWh curtailed (000)											38.16	83.46	74.36
# Events	320	244	523	646	574	690	704	597	449	177	108	167	173

Note 1: Temporary flowgates are excluded from the results.

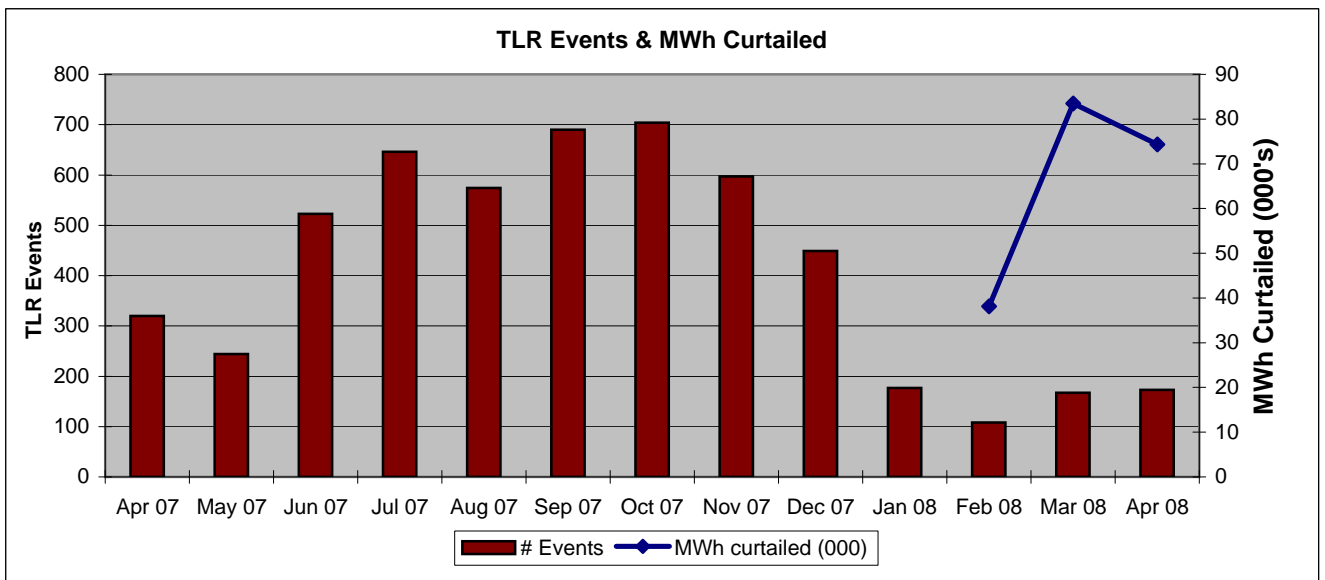


2. Regional Control Performance

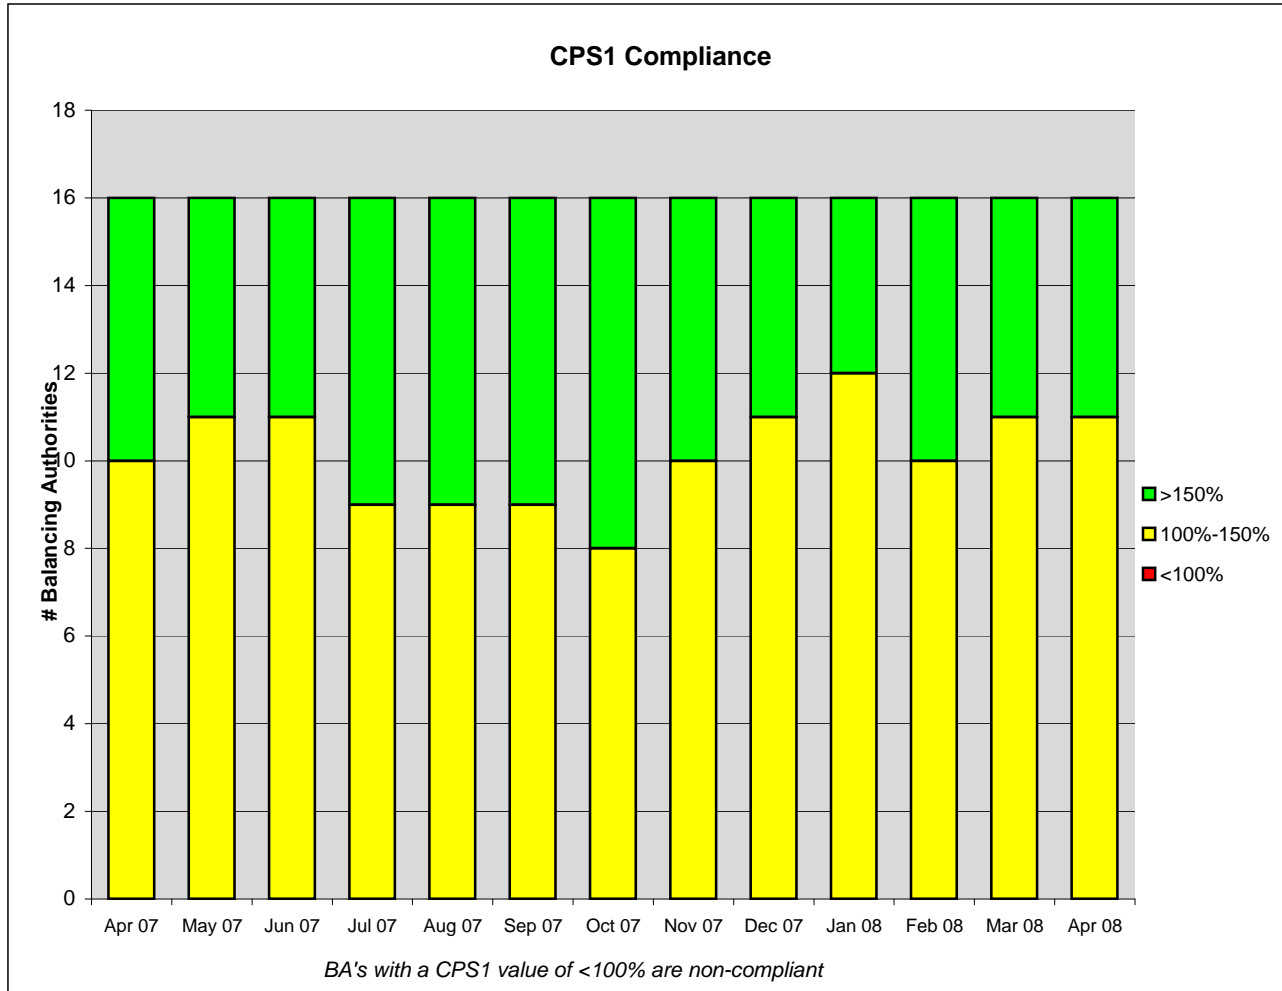


CPS1	Apr 07	May 07	Jun 07	Jul 07	Aug 07	Sep 07	Oct 07	Nov 07	Dec 07	Jan 08	Feb 08	Mar 08	Apr 08
>150%	6	5	5	7	7	7	8	6	5	4	6	5	5
100%-150%	10	11	11	9	9	9	8	10	11	12	10	11	11
<100%	0	0	0	0	0	0	0	0	0	0	0	0	0

Violation if any 1 Balancing Authority has a violation in a 12 month period.

3. Transmission Utilization Proxy

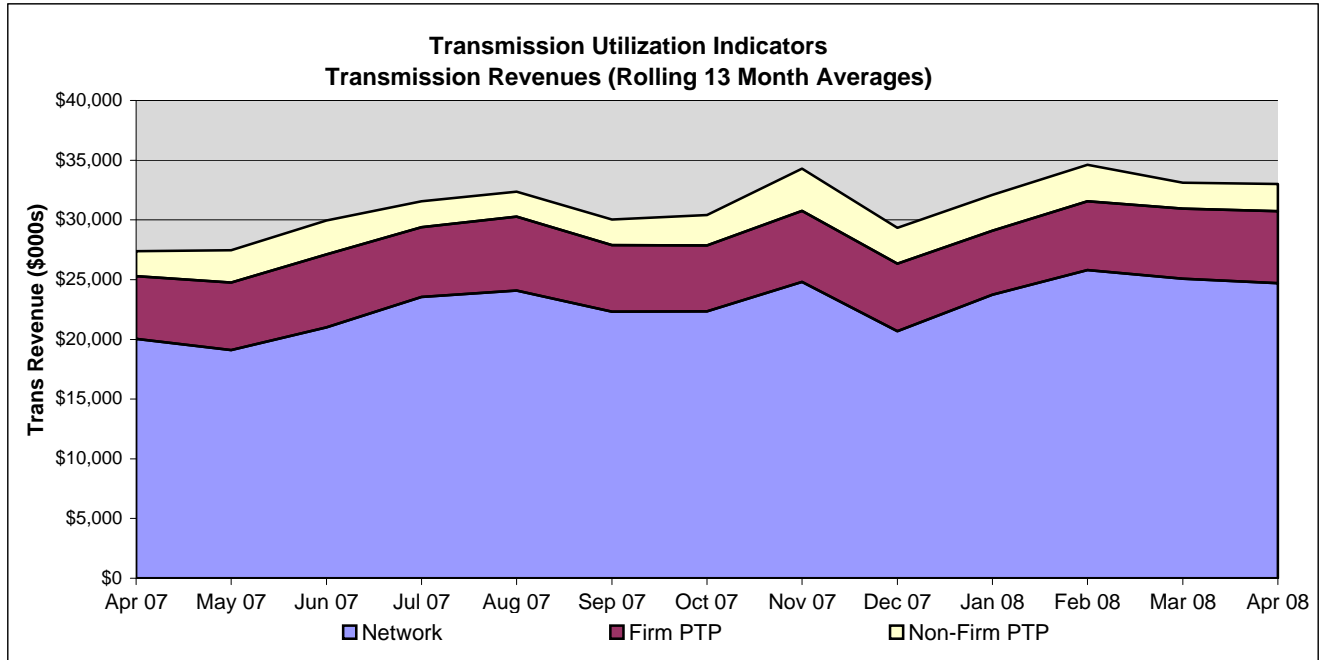


Type	Apr 07	May 07	Jun 07	Jul 07	Aug 07	Sep 07	Oct 07	Nov 07	Dec 07	Jan 08	Feb 08	Mar 08	Apr 08
Network (\$000)	\$20,033	\$19,112	\$20,991	\$23,554	\$24,094	\$22,308	\$22,356	\$24,798	\$20,672	\$23,732	\$25,798	\$25,068	\$24,701
Firm PTP (\$000)	\$5,254	\$5,643	\$6,127	\$5,841	\$6,192	\$5,589	\$5,509	\$5,951	\$5,657	\$5,357	\$5,752	\$5,877	\$6,033
Non-Firm PTP (\$000)	\$2,089	\$2,705	\$2,839	\$2,157	\$2,081	\$2,142	\$2,557	\$3,539	\$2,996	\$3,007	\$3,055	\$2,175	\$2,261

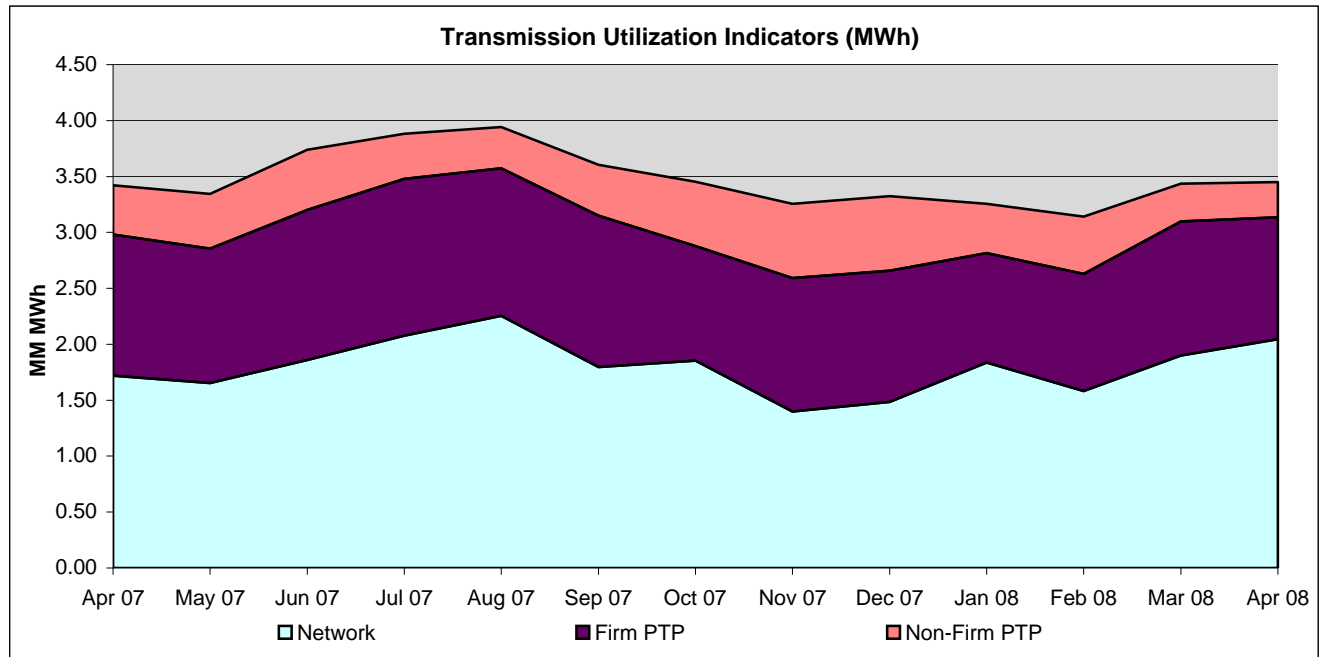


Type	Apr 07	May 07	Jun 07	Jul 07	Aug 07	Sep 07	Oct 07	Nov 07	Dec 07	Jan 08	Feb 08	Mar 08	Apr 08
Network (MM MWh)	1.72	1.65	1.86	2.08	2.25	1.80	1.85	1.40	1.48	1.84	1.58	1.90	2.05
Firm PTP (MM MWh)	1.26	1.20	1.34	1.40	1.32	1.35	1.02	1.20	1.17	0.98	1.05	1.20	1.09
Non-Firm PTP (MM MWh)	0.44	0.49	0.54	0.40	0.37	0.45	0.57	0.66	0.67	0.44	0.51	0.34	0.31
Current Year Total	3.42	3.34	3.74	3.88	3.94	3.60	3.45	3.26	3.32	3.26	3.14	3.44	3.45

4. EIS Prices and Price Range

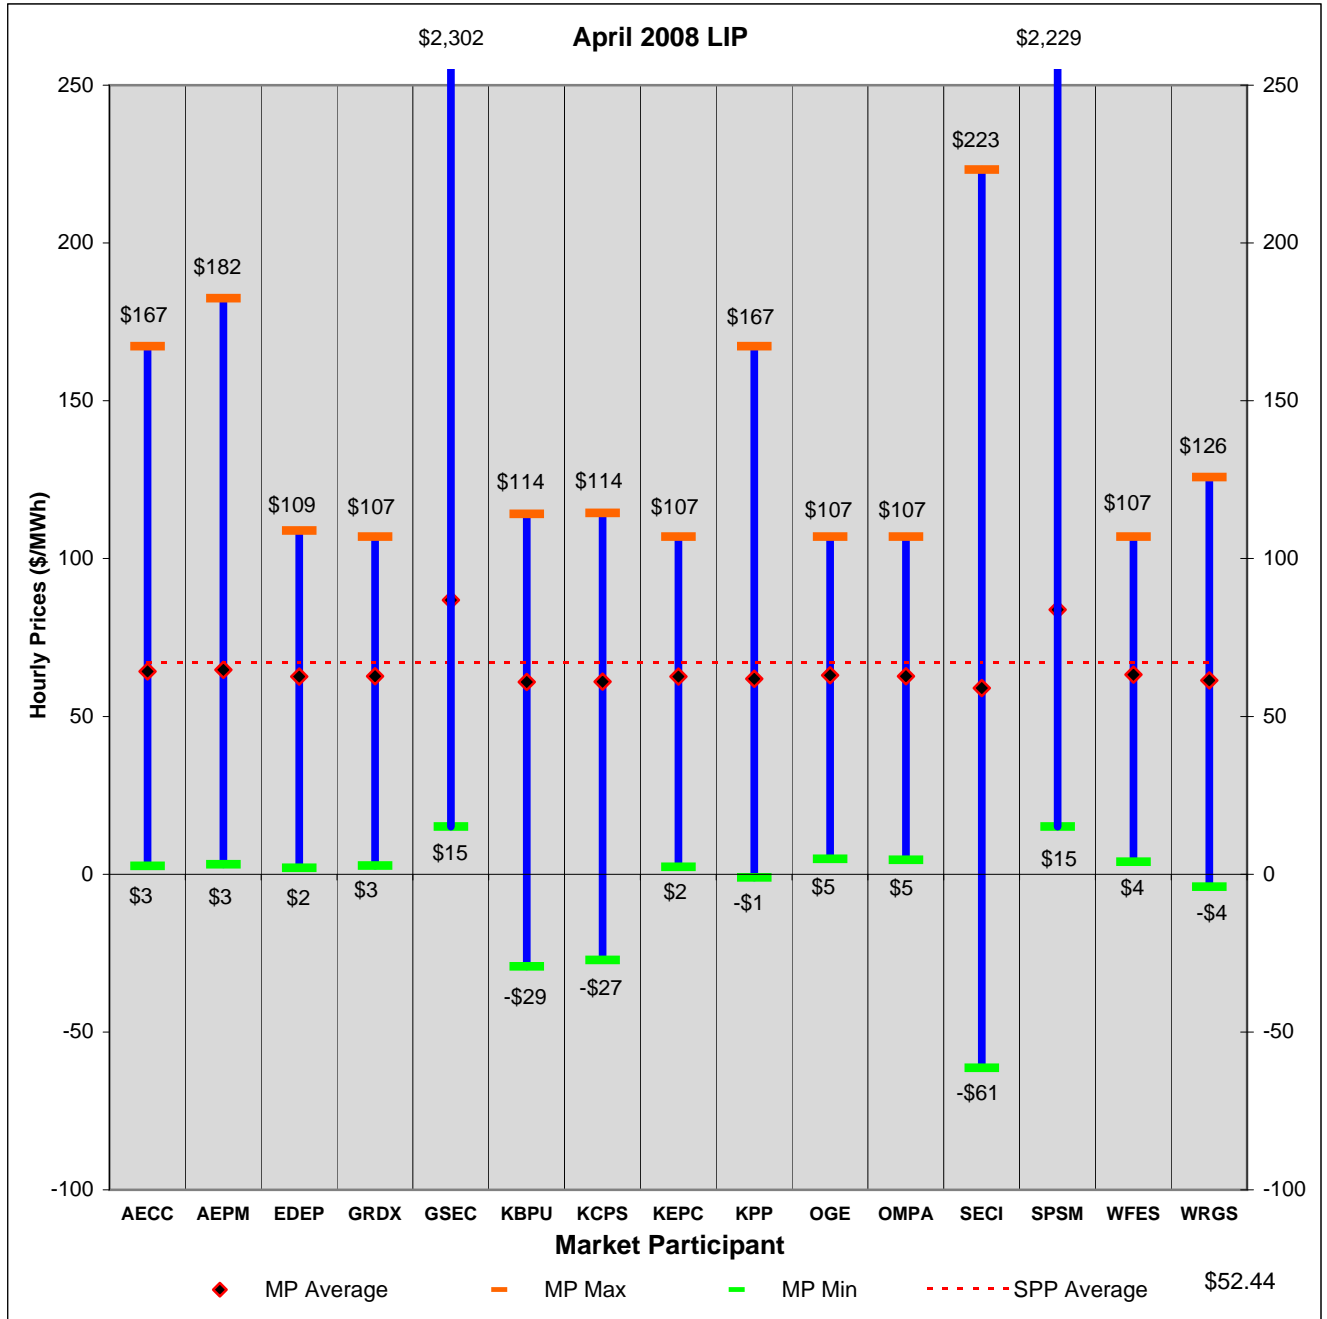


4. EIS Prices and Price Range

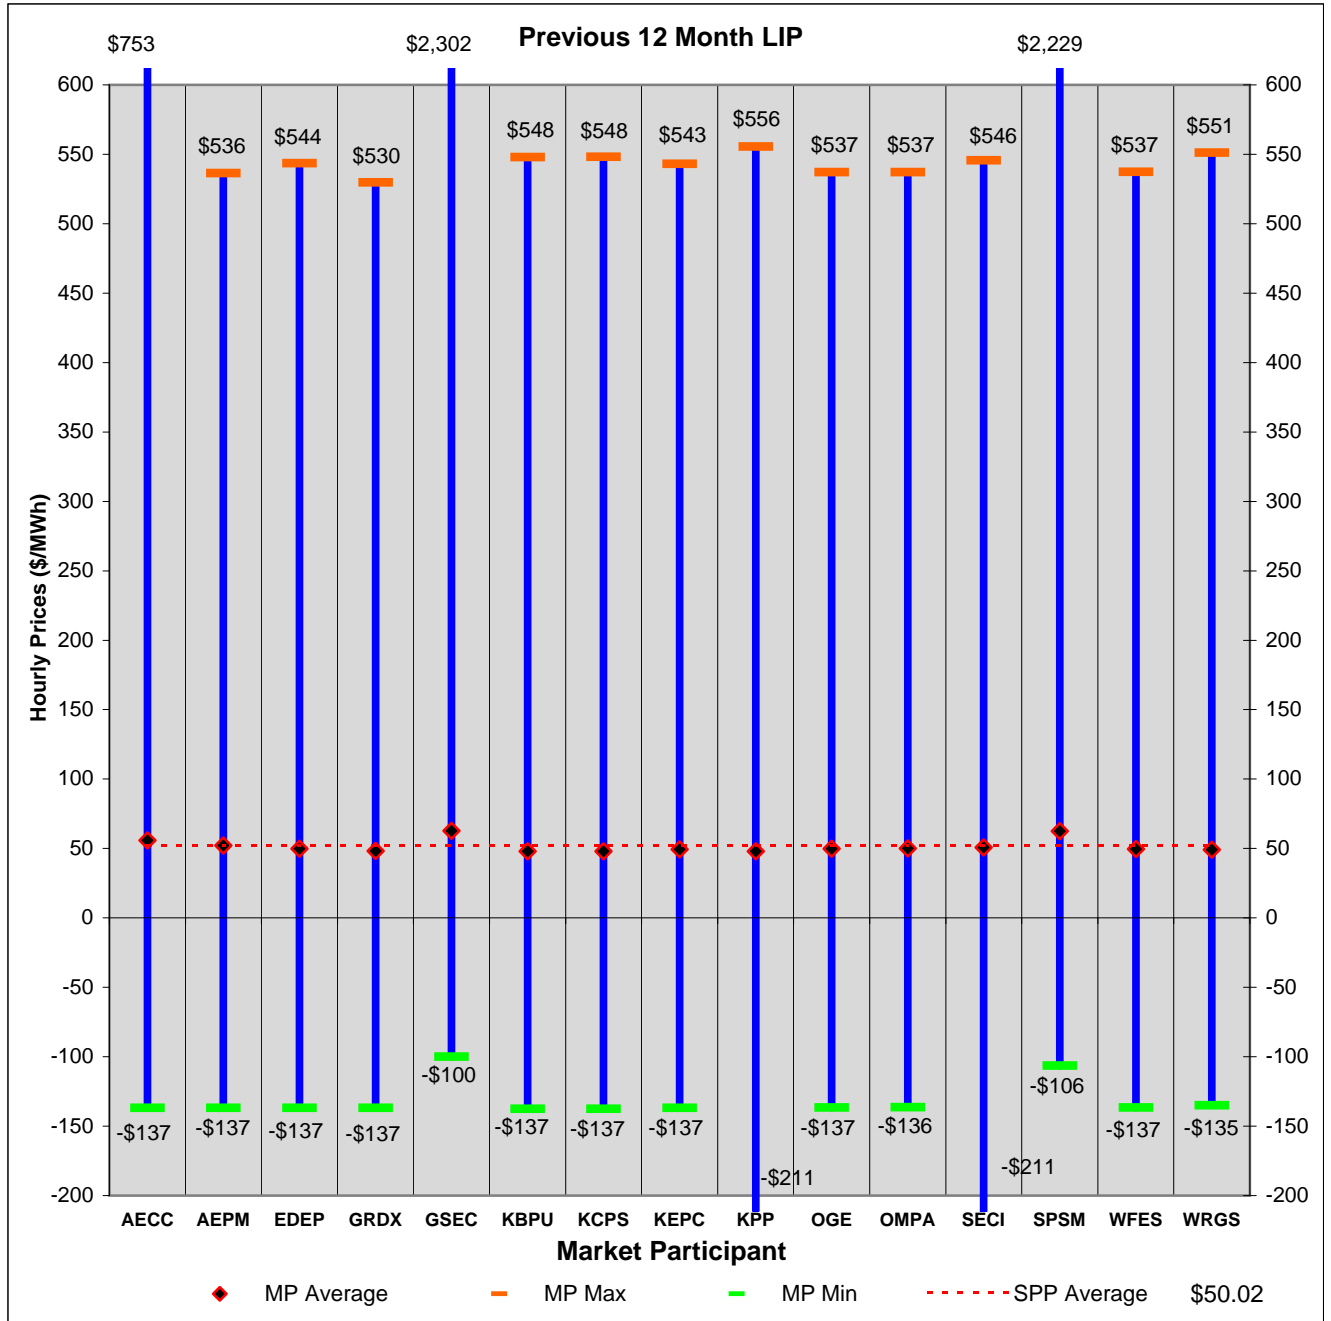

5. Congestion


This metric is being revised
 in order to provide
 a more clear and concise representation
 of how congestion is resolved
 within the SPP EIS Market.

--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

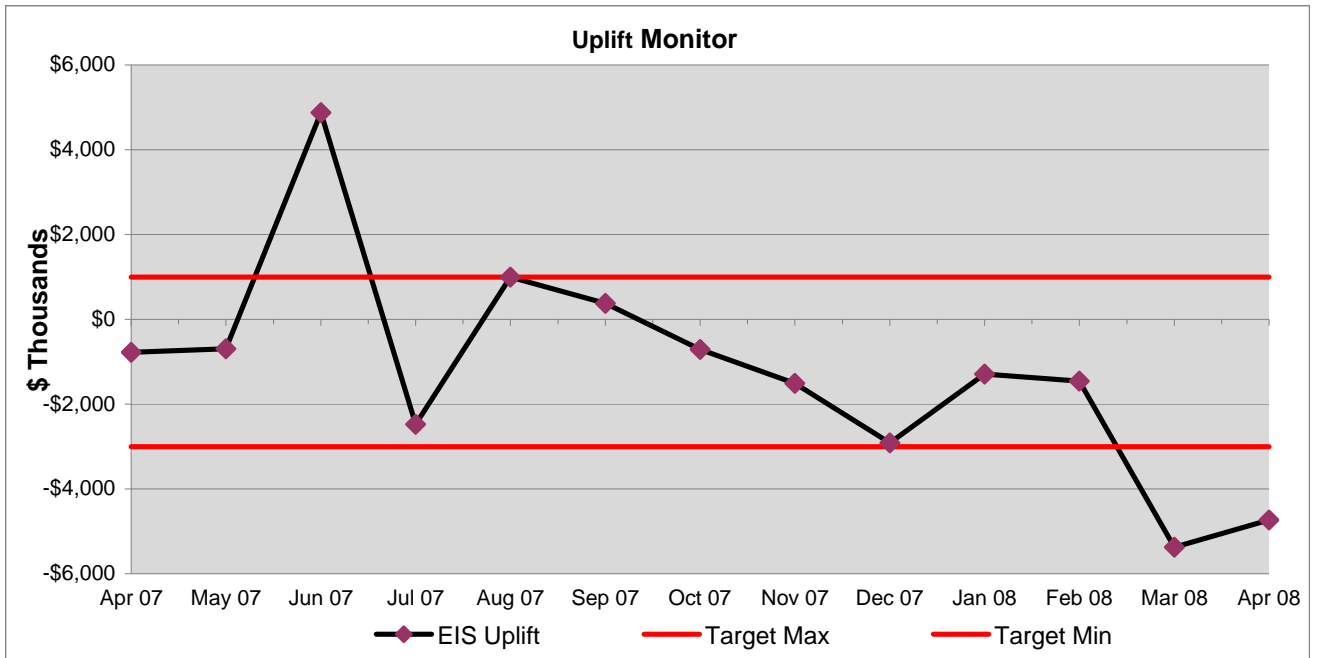


	Apr 07	May 07	Jun 07	Jul 07	Aug 07	Sep 07	Oct 07	Nov 07	Dec 07	Jan 08	Feb 08	Mar 08	Apr 08
EIS Uplift (\$000's)	-775	-695	4,879	-2,475	998	377	-709	-1,506	-2,914	-1,289	-1,455	-5,376	-4,731

6. Market Liquidity

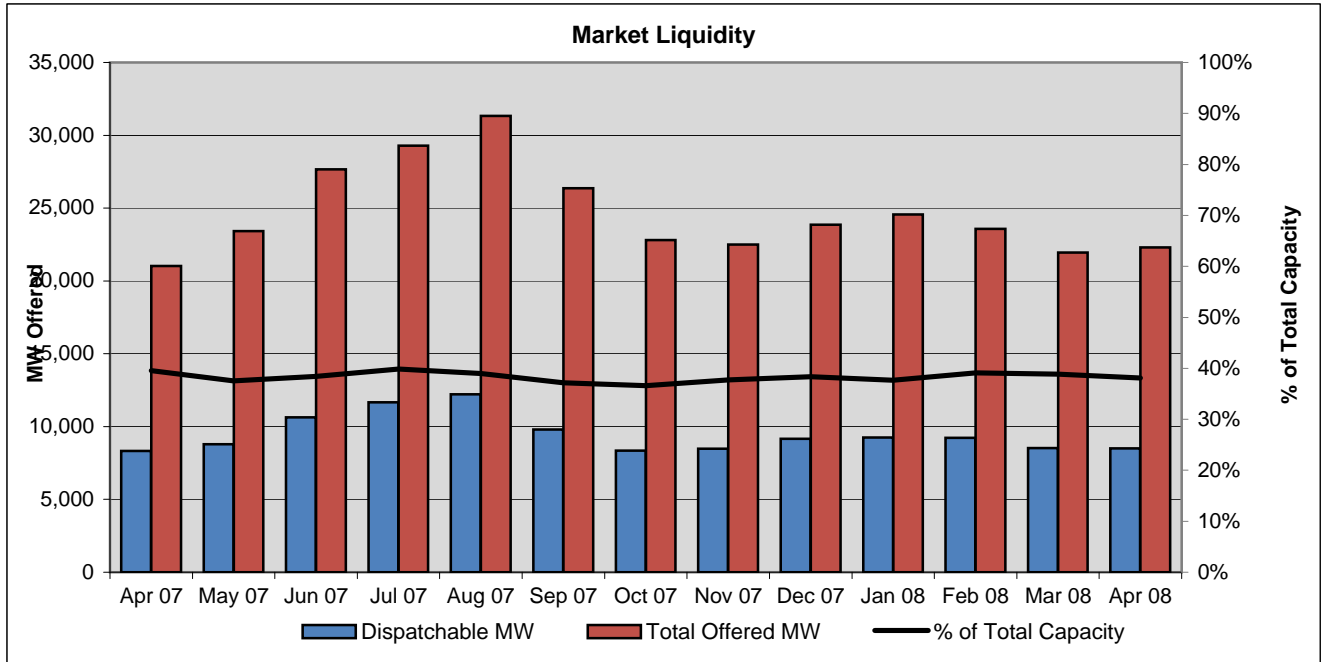


	Apr 07	May 07	Jun 07	Jul 07	Aug 07	Sep 07	Oct 07	Nov 07	Dec 07	Jan 08	Feb 08	Mar 08	Apr 08
Dispatchable MW	8,321	8,783	10,631	11,671	12,205	9,802	8,349	8,482	9,151	9,255	9,222	8,527	8,495
Total Offered MW	21,033	23,416	27,657	29,281	31,326	26,375	22,809	22,495	23,864	24,564	23,566	21,950	22,304
% of Total Capacity	40%	38%	38%	40%	39%	37%	37%	38%	38%	38%	39%	39%	38%

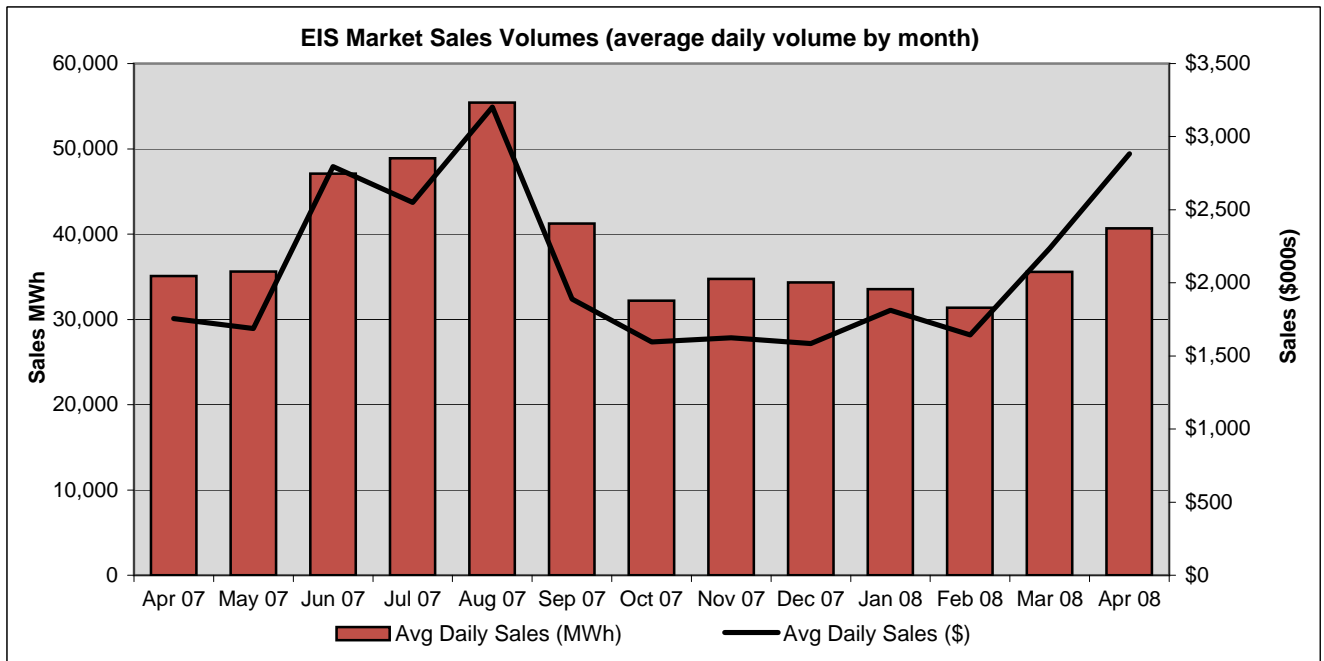

	Apr 07	May 07	Jun 07	Jul 07	Aug 07	Sep 07	Oct 07	Nov 07	Dec 07	Jan 08	Feb 08	Mar 08	Apr 08
Avg Daily Sales (MWh)	35,090	35,606	47,105	48,886	55,410	41,230	32,204	34,747	34,325	33,541	31,372	35,581	40,661
Avg Daily Sales (\$)	1,755	1,687	2,795	2,550	3,203	1,889	1,595	1,623	1,585	1,813	1,644	2,237	2,883


7. SPP Admin Fee Performance

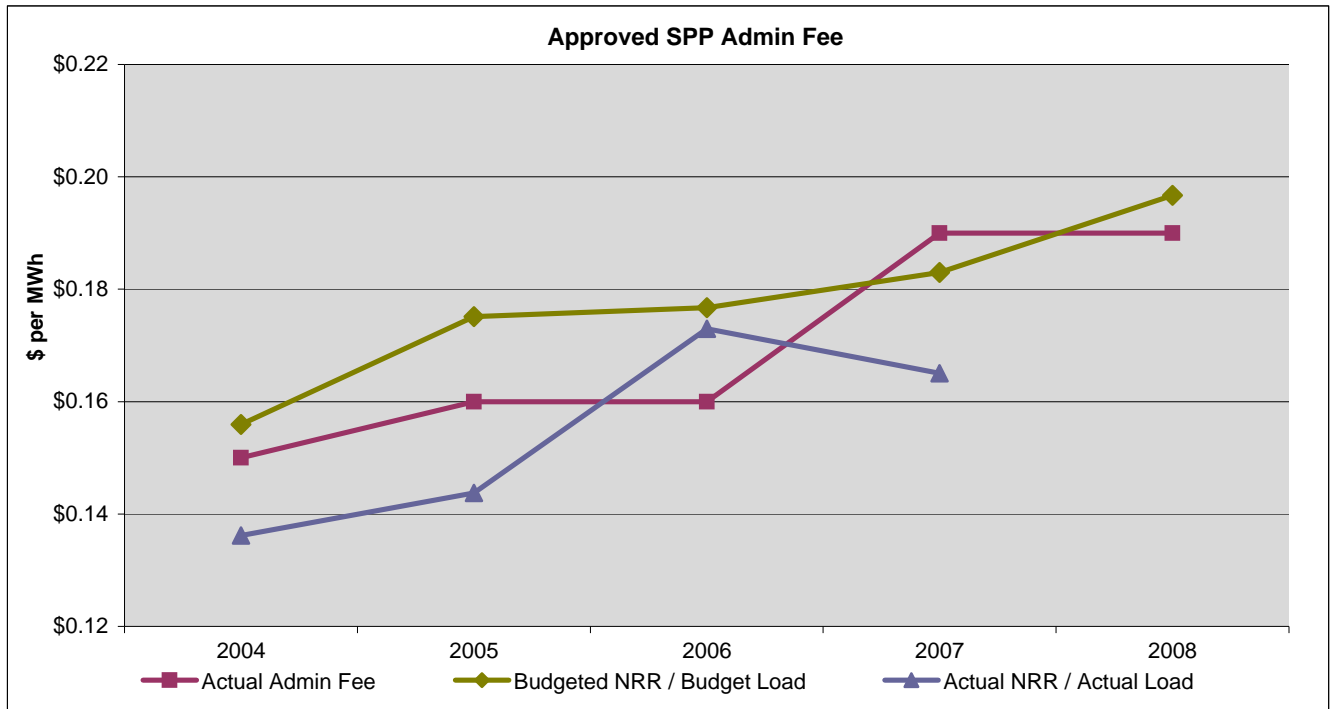

Financial Metrics


	2004	2005	2006	2007	2008
Budgeted Net Revenue Required (\$000's)	\$ 38,322	\$ 44,391	\$ 45,688	\$ 52,819	\$ 61,462
Budgeted Load (000's)	245,776	253,489	258,556	288,649	312,496
Budgeted NRR / Budget Load	\$ 0.156	\$ 0.175	\$ 0.177	\$ 0.183	\$ 0.197
Actual Admin Fee	0.15	0.16	0.16	0.19	0.19
Actual Net Revenue Required (\$000's)	\$ 33,443	\$ 38,415	\$ 49,549	\$ 49,691	\$ -
Actual Load (000's)	245,571	267,239	286,446	301,053	-
Actual NRR / Actual Load	\$ 0.136	\$ 0.144	\$ 0.173	\$ 0.165	-
EIA-411 Load Growth Forecast	-0.37%	3.05%	-0.60%	1.80%	2.10%
Actual Load Growth	-1.60%	8.82%	7.19%	5.10%	0.00%

8. Financial Settlement Index

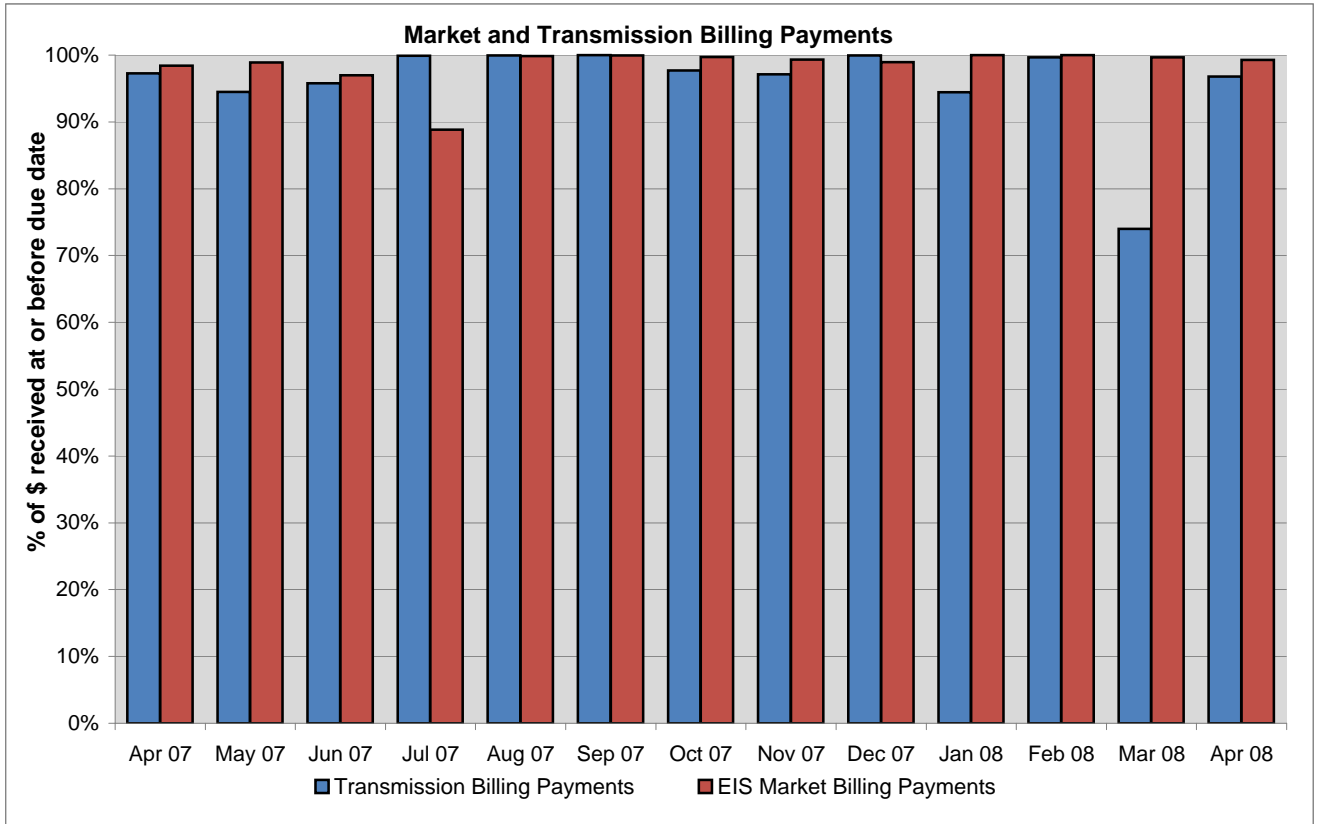


	Apr 07	May 07	Jun 07	Jul 07	Aug 07	Sep 07	Oct 07	Nov 07	Dec 07	Jan 08	Feb 08	Mar 08	Apr 08
% of Transmission Payment \$ Received at or Before the Due Date	97.3%	94.5%	95.8%	99.9%	100.0%	100.0%	97.7%	97.1%	99.9%	94.4%	99.7%	74.0%	96.8%
% of Market Payment \$ Received at or Before the Due Date	98.4%	98.9%	97.0%	88.8%	99.9%	100.0%	99.7%	99.3%	99.0%	100.0%	100.0%	99.7%	99.3%

9. Financial Disputes Index

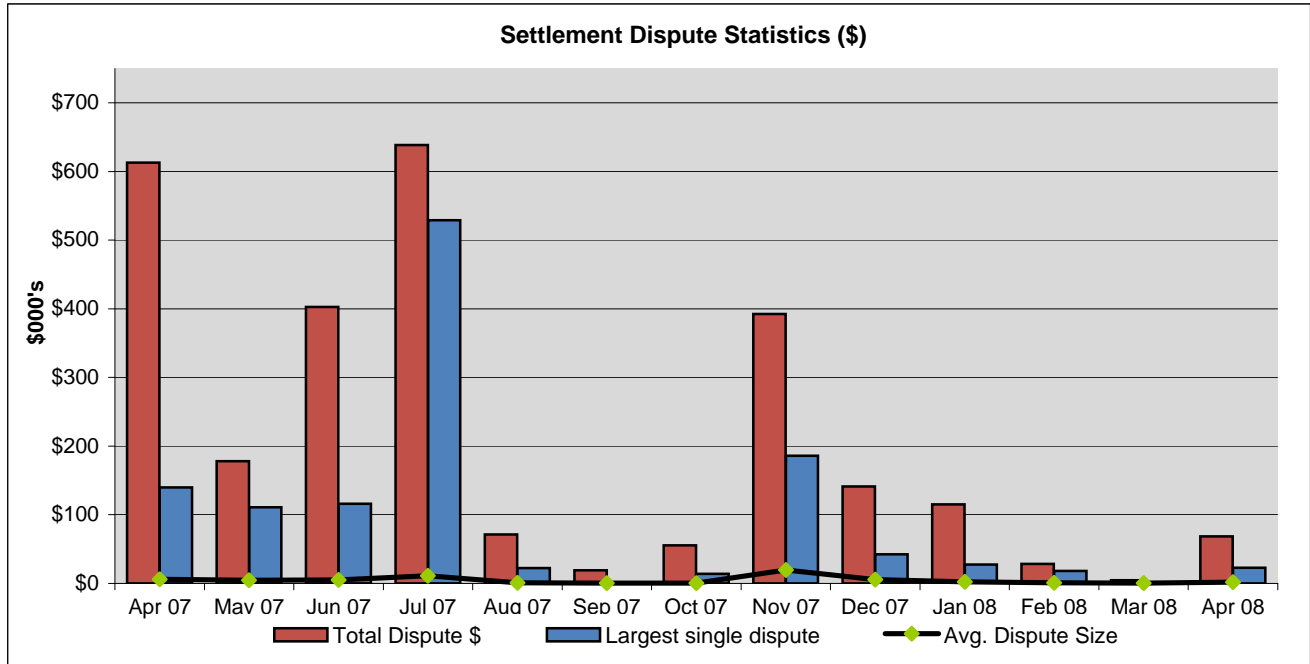


	Apr 07	May 07	Jun 07	Jul 07	Aug 07	Sep 07	Oct 07	Nov 07	Dec 07	Jan 08	Feb 08	Mar 08	Apr 08
Total Dispute \$	\$612,799	\$177,856	\$402,518	\$638,390	\$71,230	\$18,998	\$55,690	\$392,435	\$141,221	\$115,278	\$28,597	\$4,665	\$68,665
Avg. Dispute Size	\$6,008	\$4,560	\$5,095	\$11,007	\$989	\$396	\$679	\$19,622	\$5,432	\$2,452	\$953	\$359	\$2,020
Largest single dispute	\$140,054	\$110,948	\$116,061	\$528,931	\$22,384	\$1,315	\$14,073	\$186,040	\$42,497	\$27,572	\$18,038	\$1,154	\$22,985

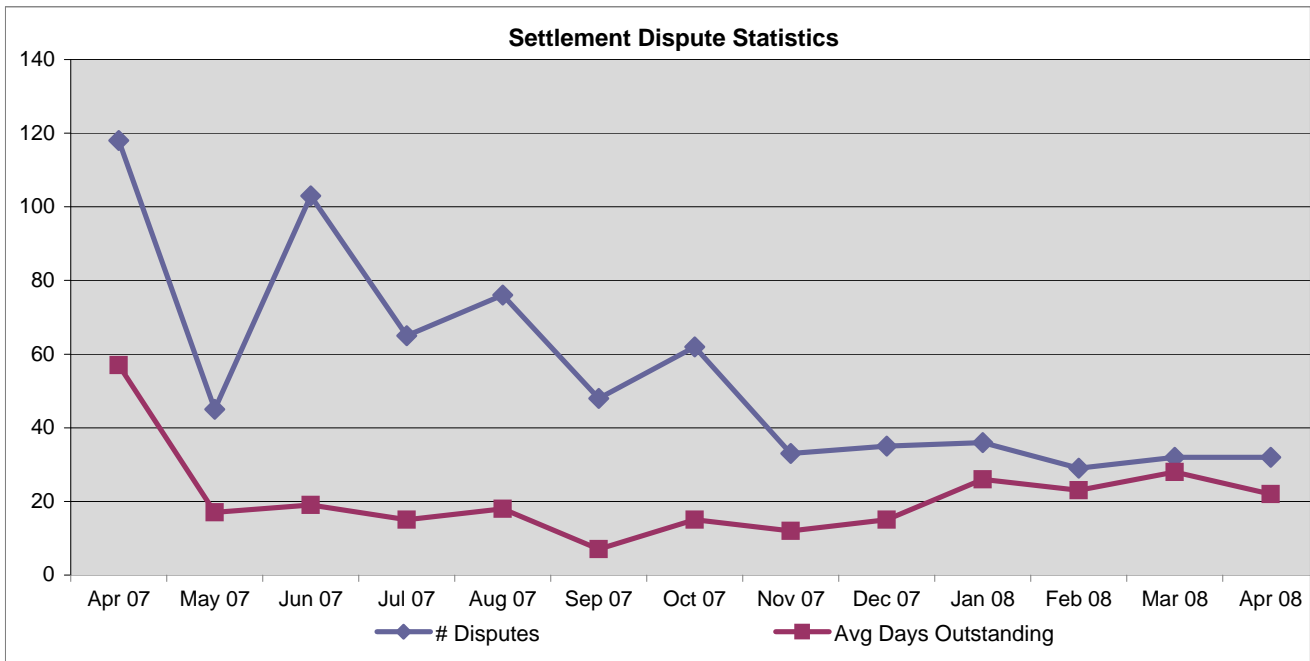

	Apr 07	May 07	Jun 07	Jul 07	Aug 07	Sep 07	Oct 07	Nov 07	Dec 07	Jan 08	Feb 08	Mar 08	Apr 08
# Disputes	118	45	103	65	76	48	62	33	35	36	29	32	32
Avg Days Outstanding	57	17	19	15	18	7	15	12	15	26	23	28	22


10. Budget Performance Monitor

Financial Metrics

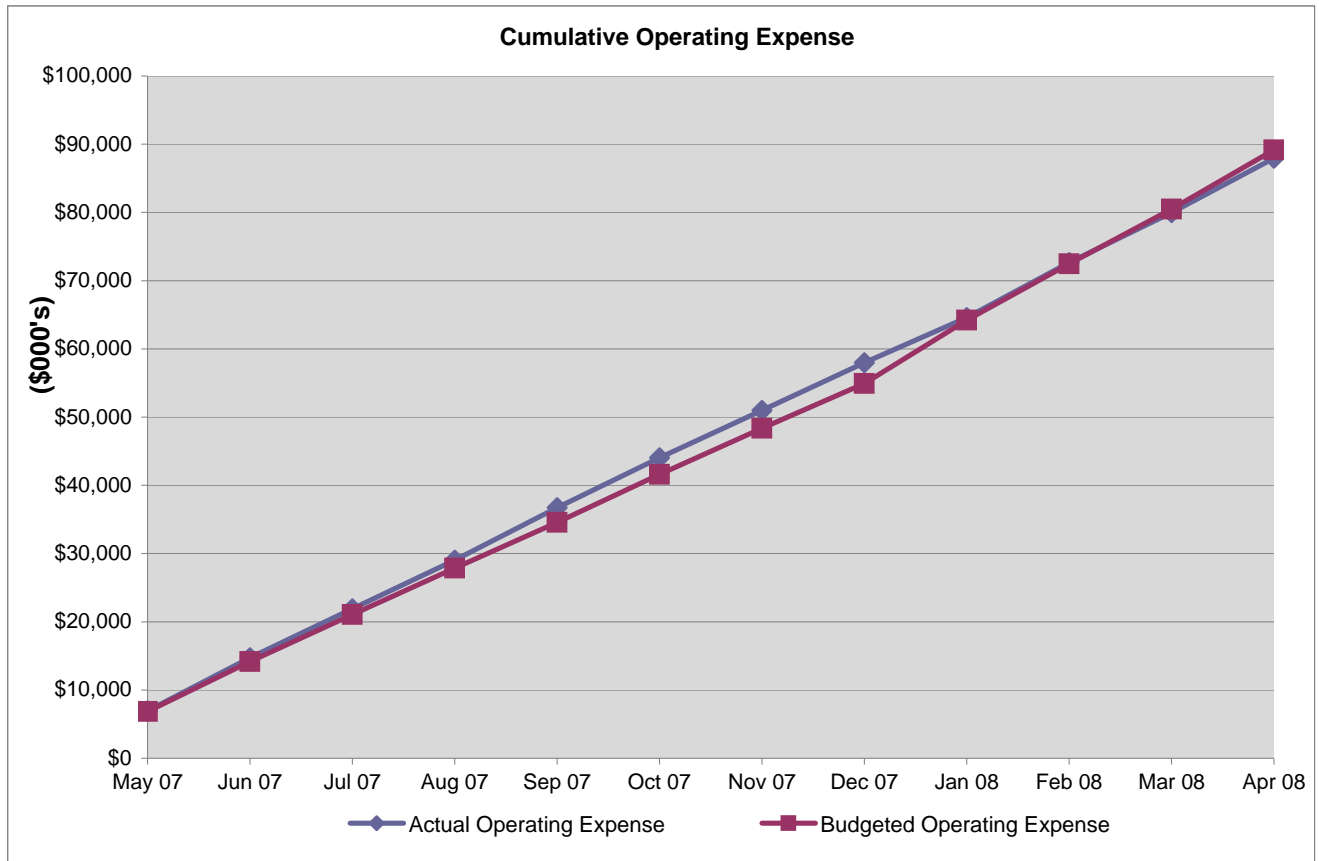


Cumulative	May 07	Jun 07	Jul 07	Aug 07	Sep 07	Oct 07	Nov 07	Dec 07	Jan 08	Feb 08	Mar 08	Apr 08
Actual Operating Expense (\$000's)	6,935	14,711	21,920	29,044	36,735	44,034	50,990	57,968	64,593	72,671	79,960	87,969
Budgeted Operating Expense (\$000's)	6,848	14,146	21,078	27,865	34,588	41,594	48,337	54,942	64,220	72,487	80,507	89,153
Variance: Fav / (Unf)	(87)	(565)	(842)	(1,179)	(2,147)	(2,440)	(2,653)	(3,026)	(373)	(184)	548	1,185
% of Variance	-1%	-4%	-4%	-4%	-6%	-6%	-5%	-6%	-1%	0%	1%	1%

11. Employee Turnover

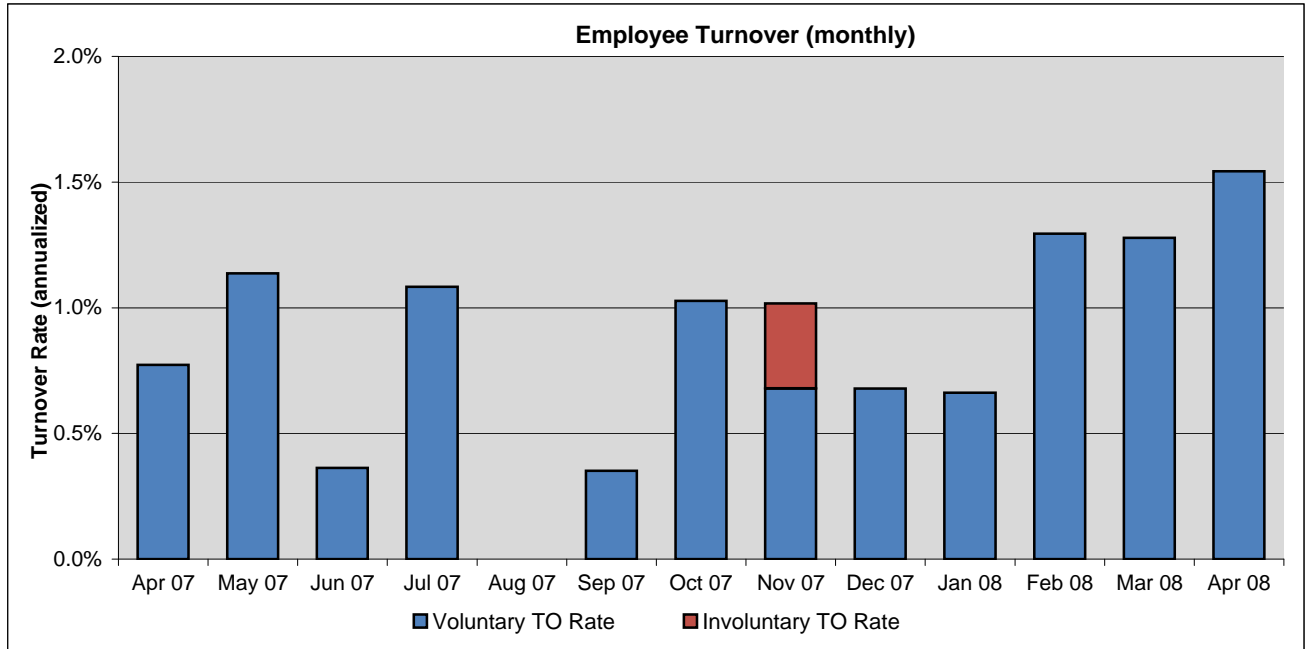


	Apr 07	May 07	Jun 07	Jul 07	Aug 07	Sep 07	Oct 07	Nov 07	Dec 07	Jan 08	Feb 08	Mar 08	Apr 08
Voluntary TO Rate	0.77%	1.14%	0.36%	1.08%	0.00%	0.35%	1.03%	0.68%	0.68%	0.66%	1.29%	1.28%	1.54%
Involuntary TO Rate	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.34%	0.00%	0.00%	0.00%	0.00%	0.00%
Total Turnover (# of employees)	2	3	1	3	0	1	3	3	2	2	4	4	5

Note: Involuntary termination in November was due to an employee death (not work-related).

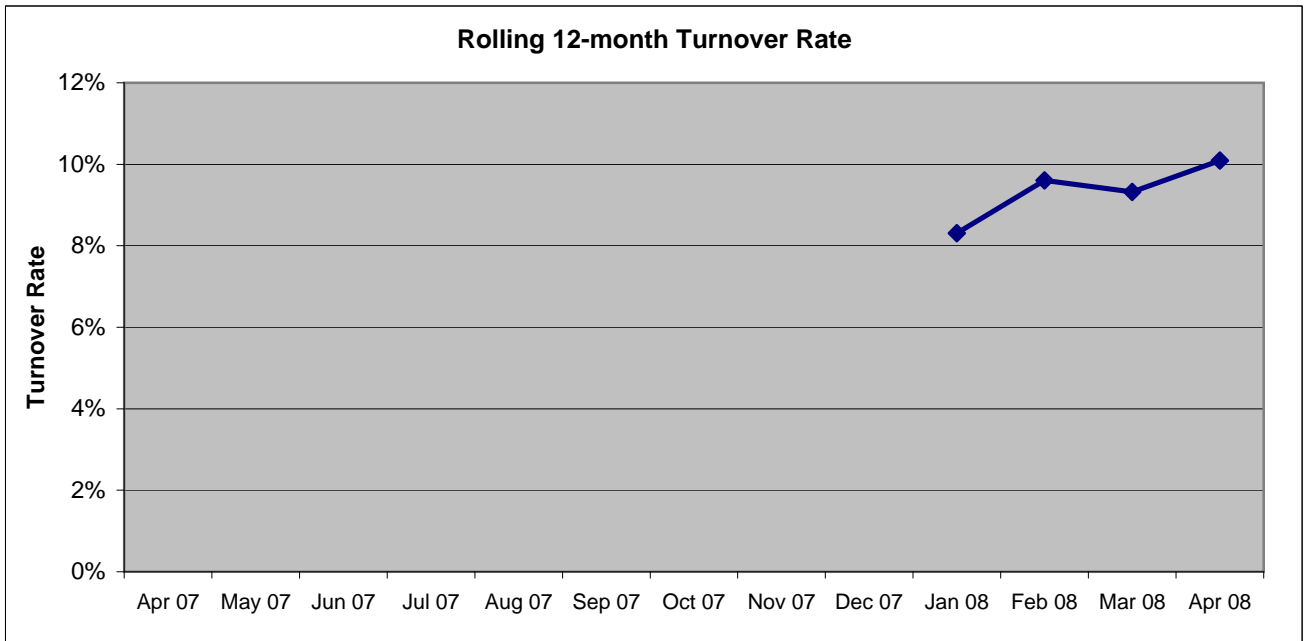

	Apr 07	May 07	Jun 07	Jul 07	Aug 07	Sep 07	Oct 07	Nov 07	Dec 07	Jan 08	Feb 08	Mar 08	Apr 08
Rolling 12-month Turnover Rate										8.31%	9.60%	9.32%	10.09%

11. Employee Turnover

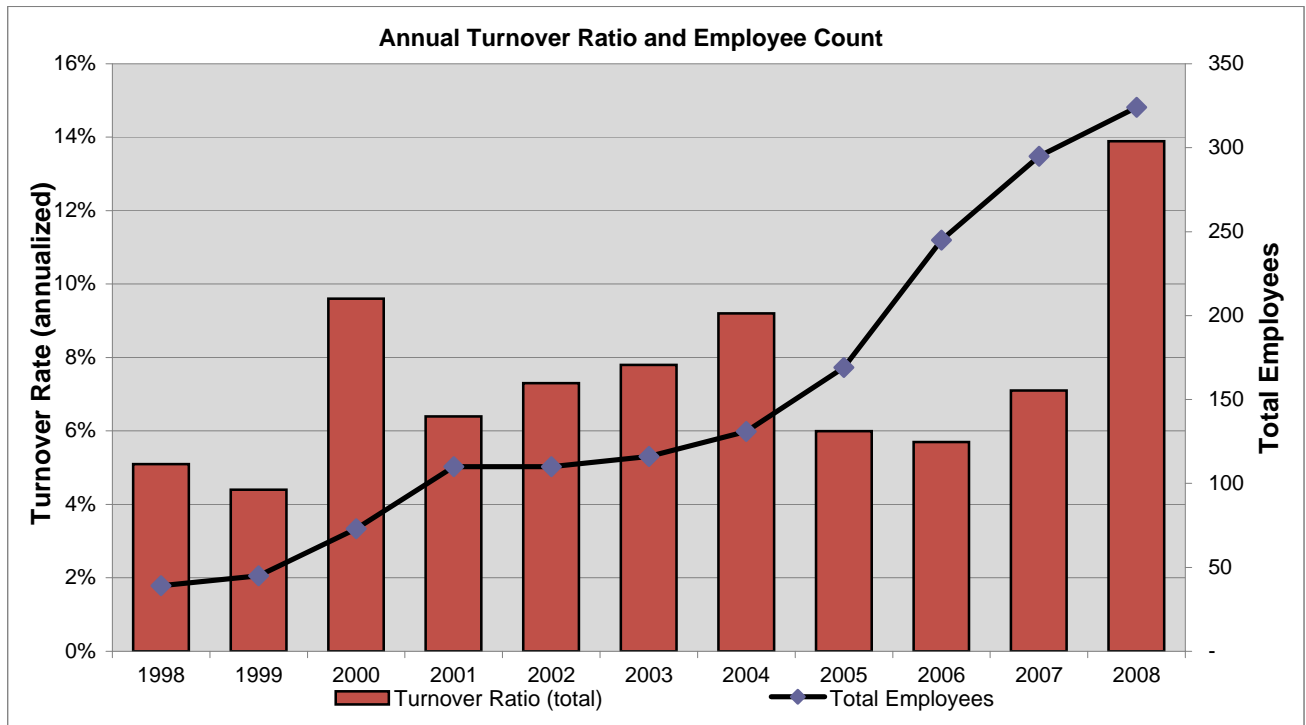

	1998	1999	2000	2001	2002	2003	2004	2005	2006	2007	2008
Total Employees	39	45	73	110	110	116	131	169	245	295	324
Turnover Ratio (total)	5.1%	4.4%	9.6%	6.4%	7.3%	7.8%	9.2%	6.0%	5.7%	7.1%	13.9%

*2008 figures are as of the end of the reported month

12. Compliance with NERC Standards**SPP RTO Compliance**

	Apr 07	May 07	Jun 07	Jul 07	Aug 07	Sep 07	Oct 07	Nov 07	Dec 07	Jan 08	Feb 08	Mar 08	Apr 08
# Confirmed Violations			0	0	0	0	0	0	0	0	0	0	0

SPP Registered Entity Compliance

	Apr 07	May 07	Jun 07	Jul 07	Aug 07	Sep 07	Oct 07	Nov 07	Dec 07	Jan 08	Feb 08	Mar 08	Apr 08
# Confirmed Violations			0	0	0	0	0	0	0	0	0	0	0

Note: Enforcable compliance program began in June 2007

13. IT System Performance

System Availability for April 2008

System	Unplanned Outages	Min	Target Uptime	Actual Uptime	Resulting Market Outage	Comments
Market System (MOS)	0	0	99.98	100.00	N	
Market Portal	0	0	99.98	100.00	N	
Reliability (EMS)	0	0	99.98	100.00	N	
Reliability (ICCP)	0	0	99.98	100.00	N	
Tariff Admin (OASIS)	0	0	99.98	100.00	N	
Scheduling (RTO_SS)	0	0	99.98	100.00	N	

* Target Uptime is calculated to be not more than 10 minutes of unplanned outages per month.

Overall EIS Market Status	NO UNPLANNED MARKET OUTAGES FOR APRIL 2008
---------------------------	--

System Availability Trends

System	Apr-07	May-07	Jun-07	Jul-07	Aug-07	Sep-07	Oct-07	Nov-07	Dec-07	Jan-08	Feb-08	Mar-08	Apr-08
Market System (MOS)				100.00	100.00	100.00	99.92	99.92	100.00	99.28	100.00	99.90	99.90
Market Portal				100.00	99.83	100.00	100.00	99.97	100.00	100.00	100.00	100.00	100.00
Reliability (EMS)				100.00	100.00	99.99	99.90	99.80	99.81	100.00	100.00	100.00	100.00
Reliability (ICCP)				100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00	99.92	99.92
Tariff Admin (OASIS)				99.80	100.00	100.00	100.00	99.99	100.00	100.00	100.00	100.00	100.00
Scheduling (RTO_SS)				100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00



No unplanned outages



less than 10 minutes unplanned outages



10 minutes or more unplanned outages

Historical data prior to July 2007 is not available.

Southwest Power Pool Metrics Definitions

Transmission & Market Indicators	Summary of Regional Operational Performance Indicators	
	<p>Two groups of metrics will be monitored to provide an overall health indication of the regional transmission system and market. There are two primary areas of interest:</p> <ul style="list-style-type: none"> • Reliability Performance Indicators, which focus on the actual operations of the transmission system and whether or not it was operated within expected limits and standards. • Market Performance Indicators, which focus on the performance of the market in terms of overall volume, prices and level of participation. <p>The intent is to monitor the trends in these areas over time to identify any unexpected performance in an area. Specific performance targets may be established in the future as experience is gained with the information.</p>	
	<p>Purpose of Reliability Performance Indicators</p> <p>This sub-group of metrics is designed to measure the operations of the transmission system from a reliability perspective in the prior 12 month period. Together, they form an aggregate representation to answer the following questions:</p> <ul style="list-style-type: none"> • Were any operating limits violated in the period and if so, how severe was the situation? (see Active Transmission Control Indicators) • Was the system operated in compliance with the relevant control performance standards? (see Regional Control Performance) 	
<p>1. Active Transmission Control Indicators</p>	<p>Provides a set of measures on the number of minutes control actions are taken to reduce the flow on one or more facilities below its System Operating Limit (SOL) or IROL limit. For each month, the following items are reported:</p> <ul style="list-style-type: none"> • Total minutes in period – is the total minutes in the month control actions were required. • Ratio of Short/Longer Duration events – is the ratio of the total number of minutes where the event duration was less than 5 minutes to the total number of minutes where the event duration was greater than 5 minutes. • Duration of longest event – is the maximum number of minutes for an event in the month. • Total number of events in the period <ul style="list-style-type: none"> - Normal operations (green) – The event was managed in less than 5 minutes. - High control activity required (yellow/orange) – the event took more than 5 minutes but less than 20 minutes (yellow) or less than 30 minutes (orange) to control, however, no IROL violations occurred. - Significant event occurrence (red) – control actions were required to eliminate one or more IROL violations in the month. 	

2. Regional Control Performance

Measures the aggregate performance to the NERC CPS (Control Performance Standards) of the Balancing Authorities in the region. This indicator is set based on the number of BAs within region that are in compliance with the NERC real time control performance standards (known as BAL-001 – Real Power Balancing Control Performance and BAL-002 – Disturbance Control Performance).

- CPS1 requires BAs to be in compliance for 100% of the periods measured within the month; and CPS2 requires BAs to be in compliance for 90% of the periods measured within the month.
- For the CPS1 standard, each BA's rolling 12 month performance is grouped into one of three performance bands (<100% [red], 100-150% [yellow], >150% [green]).
- The number of BA's whose CPS1 score falls into these bands is shown; with below 100% meaning non-compliant with the standard.
- CPS2 performance is depicted in the appropriate bands (<90% [red], 90-95% [yellow], >95% [green]) based on the monthly CPS2 score rather than a rolling 12 month average.

Purpose of Market Performance Indicators

This sub-group of indicators provides a view of the effectiveness of the EIS market in the context of answering the following questions:

- What was the value of transmission services used in the month? (see Transmission Utilization Proxy)
- What was the average wholesale price paid in the region and what was its volatility? (see Price and Price Range)
- How much of the total congestion could be resolved through market mechanisms? (see Congestion Resolved by Market)
- What was the level of available generation offered to the market and EIS related energy sales in the month? (see Market Liquidity)

3. Transmission Utilization Proxy

Measures the volume of transmission service scheduled in the month in terms of the transmission service revenues paid by both Network Customers and Point-to-Point customers.

- The revenues paid by transmission customers are directly related to the amount of transactions scheduled on the transmission system and therefore provide a proxy as to the utilization of the transmission system in the period.
- The figure reported will be a simple sum of the transmission service revenues paid for Network Service, Firm Point-to-Point, and Non-Firm Point-to-Point transmission service.
- Figures will be reported on a rolling thirteen month basis to allow comparison to prior seasons and similar months.

4. Price and Price Ranges

Shows the EIS market prices for each market participant within the footprint on both a 12-month rolling average and for the previous month. It provides a summary of the average, high and low prices in each period.

5. Congestion Resolution & Uplift Measures

This metric is undergoing re-development.

Measures the % of MWh of the total congestion MWh resolved by the EIS Market. The objective is to monitor how often market mechanisms versus non-market mechanisms are able to resolve congestion on the system.

- For comparison, the total EIS Uplift dollar amount is included.
- Although no specific performance targets are being set at this time, the intent is to monitor the trend of this index to identify significant deviations from average.

Transmission & Market Indicators	6. Market Liquidity	<p>Measures the average daily MW capacity offered to the EIS market (dispatchable generation); presented as a percent of daily average capacity available in the hour.</p> <ul style="list-style-type: none"> • Data was taken from the Resource Plans. • Average daily MWh sales into the EIS Market and their dollar value are shown as well. • Although no specific performance targets are being set at this time, the intent is to monitor the trend of this index to identify significant deviations from average.
----------------------------------	----------------------------	---

Financial Metrics	<i>Purpose of Financial Metrics</i>	
	This group of metrics provides a view of the organization's overall financial situation in terms of both the operating costs and settlement functions carried out.	
	7. SPP Admin Fee Performance (Rolling)	Measures actual costs incurred by SPP on an annual basis and compares this to the approved Admin Fee and Budgeted Net Revenue Requirement (NRR).
	8. Financial Settlement Index	Metric measures the timeliness of the financial settlements for both transmission billing and EIS market billing and provides a proxy for the strength of the organization's cash flow.
	9. Financial Disputes Index	<p>Measures the number and value of disputes made with regards to the financial settlements of the markets. The objective in this area is twofold: (1) minimize the time to clear disputes; and (2) minimize the total value of dollars in dispute. The monthly indicators are the following three variables:</p> <p style="margin-left: 40px;">Total number of disputes Total dollars in dispute Average # days to resolve disputes</p>
10. Budget Performance Monitor	Measures the total actual operating expenses against the total budgeted operating expenses across the organization.	

Learning & Growth	<i>Purpose of Learning & Growth Metrics</i>	
	These indicators provide insights to the organization's success in maintaining and supporting its desired staffing levels and employee growth plans.	
11. Overall Turnover	Measures both involuntary and voluntary turnover rates in the organization. Monthly turnover is charted on a rolling 12 month basis, while annual turnover ratio and number of employees is provided for historical purposes.	

Performance	<i>Purpose of Performance Metrics</i>	
	This Performance Metrics are divided into two categories, quarterly and annual, which describe the frequency with which they will be monitored. The metrics in this group focus on compliance and achievement of major initiatives. Only the NERC Compliance metric is reported as part of the Metrics Report document. The other measures in this category will be reported on a periodic basis in separate reports.	
	12. NERC Compliance	Measures SPP's compliance with all NERC standards. Status is green unless there is a self-reported violation of any criteria during the period. This metric excludes the control performance standards which are included in the Regional Control Performance metric.
13 IT System Availability	Measures availability of SPP IT Systems. Target uptime for all systems is calculated to be not more than 10 minutes of unplanned outage per month. However, 100% availability is always the ultimate goal. Boxes showing green represent 100% actual uptime; yellow represents less than 100% uptime but under 10 minutes of unplanned outage; while red represents 10 minutes or more of unplanned outage.	